


N353: projecteur - Blanc Chaud - optique flood



$I_{\max}=4145 \text{ cd}$ 90° 180° 90° 4000 $\alpha = 40^\circ$	Lux			
	h	d	Em	E _{max}
	2	1.5	806	1036
	4	2.9	201	259
	6	4.4	90	115
8	5.8	50	65	

Isolux

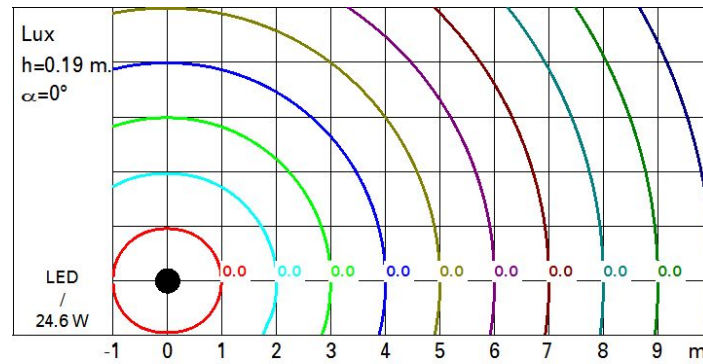


Diagramme UGR

Corrected UGR values (at 3000 lm bare lamp luminous flux)											
Riflect.:											
ceil/cav		0.70	0.70	0.50	0.50	0.30	0.70	0.70	0.50	0.50	0.30
walls		0.50	0.30	0.50	0.30	0.30	0.50	0.30	0.50	0.30	0.30
work pl.		0.20	0.20	0.20	0.20	0.20	0.20	0.20	0.20	0.20	0.20
Room dim		viewed crosswise					viewed endwise				
x	y										
2H	2H	20.6	21.3	20.9	21.5	21.8	20.6	21.3	20.9	21.5	21.8
	3H	20.5	21.1	20.8	21.4	21.6	20.5	21.1	20.8	21.4	21.6
	4H	20.4	21.0	20.8	21.3	21.6	20.4	21.0	20.8	21.3	21.6
	6H	20.4	20.9	20.7	21.2	21.5	20.4	20.9	20.7	21.2	21.5
	8H	20.3	20.8	20.7	21.1	21.5	20.3	20.8	20.7	21.1	21.5
	12H	20.3	20.7	20.7	21.1	21.4	20.3	20.7	20.7	21.1	21.4
4H	2H	20.4	21.0	20.8	21.3	21.6	20.4	21.0	20.8	21.3	21.6
	3H	20.3	20.7	20.7	21.1	21.4	20.3	20.7	20.7	21.1	21.4
	4H	20.2	20.6	20.6	21.0	21.4	20.2	20.6	20.6	21.0	21.4
	6H	20.1	20.5	20.5	20.9	21.3	20.1	20.5	20.5	20.9	21.3
	8H	20.1	20.4	20.5	20.8	21.2	20.1	20.4	20.5	20.8	21.2
	12H	20.0	20.3	20.5	20.7	21.2	20.0	20.3	20.5	20.7	21.2
8H	4H	20.1	20.4	20.5	20.8	21.2	20.1	20.4	20.5	20.8	21.2
	6H	20.0	20.2	20.4	20.7	21.2	20.0	20.2	20.4	20.7	21.2
	8H	19.9	20.1	20.4	20.6	21.1	19.9	20.1	20.4	20.6	21.1
	12H	19.9	20.1	20.4	20.5	21.1	19.9	20.1	20.4	20.5	21.1
12H	4H	20.0	20.3	20.5	20.7	21.2	20.0	20.3	20.5	20.7	21.2
	6H	19.9	20.1	20.4	20.6	21.1	19.9	20.1	20.4	20.6	21.1
	8H	19.9	20.1	20.4	20.5	21.1	19.9	20.1	20.4	20.5	21.1
Variations with the observer position at spacing:											
S =	1.0H	5.6 / -18.6					5.6 / -18.6				
	1.5H	8.4 / -23.3					8.4 / -23.3				
	2.0H	10.4 / -25.0					10.4 / -25.0				