
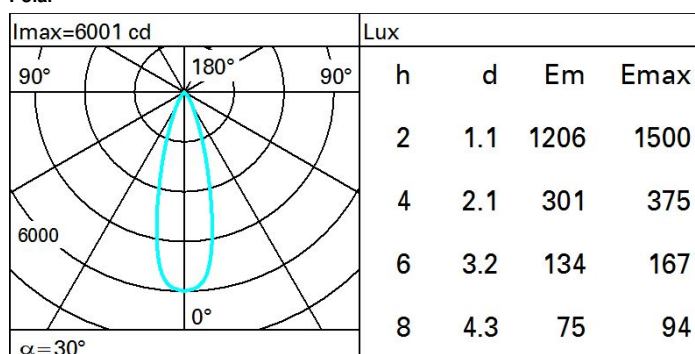


6344: con equipo electrónico 35W HIT (CDM-TC) - Flood
MIN: Minimal regulation



Isolux

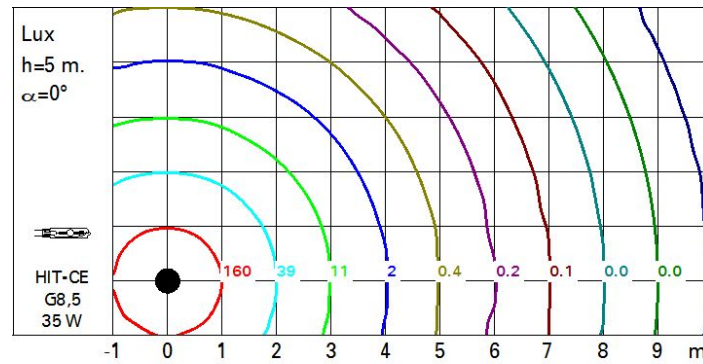


Diagrama UGR

Corrected UGR values (at 3400 lm bare lamp luminous flux)											
Reflect.:		viewed crosswise					viewed endwise				
ceiling/cav		0.70	0.70	0.50	0.50	0.30	0.70	0.70	0.50	0.50	0.30
walls		0.50	0.30	0.50	0.30	0.30	0.50	0.30	0.50	0.30	0.30
work pl.		0.20	0.20	0.20	0.20	0.20	0.20	0.20	0.20	0.20	0.20
Room dim		x					y				
2H	2H	14.9	15.5	15.2	15.7	15.9	14.9	15.5	15.2	15.7	15.9
	3H	14.8	15.3	15.1	15.6	15.9	14.8	15.3	15.1	15.6	15.8
	4H	14.8	15.2	15.1	15.5	15.8	14.7	15.2	15.1	15.5	15.8
	6H	14.7	15.1	15.0	15.4	15.8	14.7	15.1	15.0	15.4	15.7
	8H	14.6	15.1	15.0	15.4	15.7	14.6	15.0	15.0	15.4	15.7
	12H	14.6	15.0	15.0	15.4	15.7	14.6	15.0	15.0	15.3	15.7
4H	2H	14.7	15.2	15.1	15.5	15.8	14.8	15.2	15.1	15.5	15.8
	3H	14.6	15.0	15.0	15.4	15.7	14.6	15.0	15.0	15.4	15.7
	4H	14.6	14.9	14.9	15.3	15.7	14.6	14.9	14.9	15.3	15.7
	6H	14.5	14.8	14.9	15.2	15.6	14.5	14.8	14.9	15.2	15.6
	8H	14.4	14.7	14.9	15.1	15.6	14.4	14.7	14.9	15.1	15.6
	12H	14.4	14.6	14.8	15.1	15.5	14.4	14.6	14.8	15.1	15.5
8H	4H	14.4	14.7	14.9	15.1	15.6	14.4	14.7	14.9	15.1	15.6
	6H	14.3	14.6	14.8	15.0	15.5	14.3	14.6	14.8	15.0	15.5
	8H	14.3	14.5	14.8	15.0	15.5	14.3	14.5	14.8	15.0	15.5
	12H	14.2	14.4	14.7	14.9	15.4	14.2	14.4	14.7	14.9	15.4
12H	4H	14.4	14.6	14.8	15.1	15.5	14.4	14.6	14.8	15.1	15.5
	6H	14.3	14.5	14.8	15.0	15.5	14.3	14.5	14.8	15.0	15.5
	8H	14.2	14.4	14.7	14.9	15.4	14.2	14.4	14.7	14.9	15.4
Variations with the observer position at spacing:											
S =		1.0H	5.2 / -9.5				5.2 / -9.5				
		1.5H	8.0 / -10.8				8.0 / -10.8				
		2.0H	10.0 / -11.5				10.0 / -11.5				